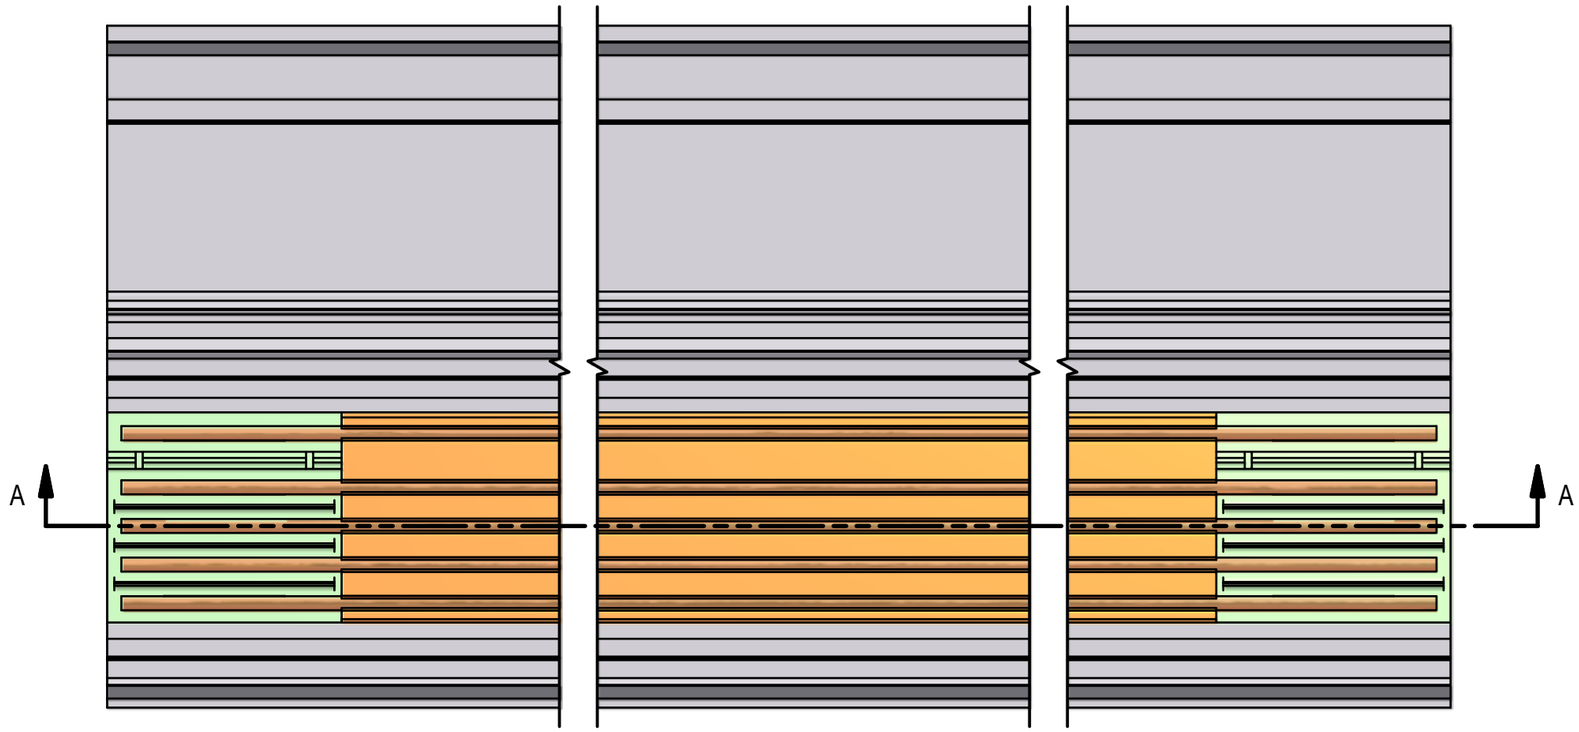

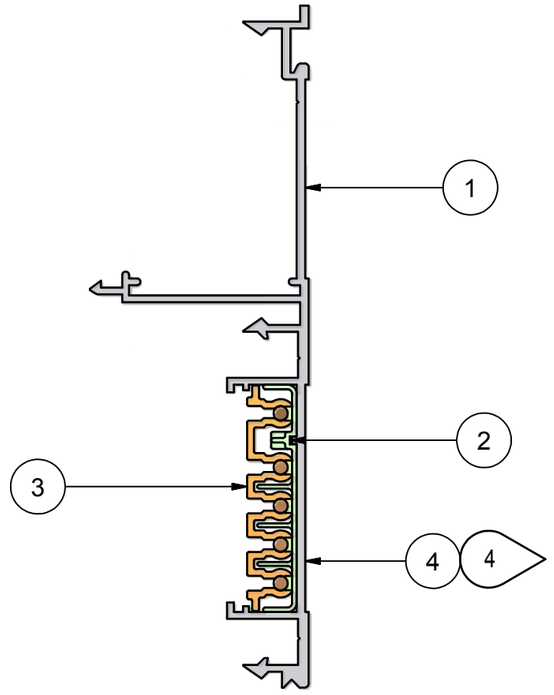

.125
.500 MAX
RECESS REF DIM.

1.405 ± .031
COPPER WIRE TO
INSULATOR PROFILE

STANDARD LENGTH - 120"

SECTION A-A
SCALE 3/4

NOTES:

1. GLUE JOINT INSULATOR INTO PLACE USING CYBERBOND 2150
   OBSERVE PROPER ORIENTATION AS SHOWN
2. CUT INSULATOR PROFILE TO HOUSING NOMINAL LENGTH -.562
   OVERALL TOLERANCE ± .062
3. MARKINGS: AMPS, VOLTS, CAT NO., 10,000 SHORT CIRCUIT AMPS
4. PLACE LABEL (P/N:240-0026-0G03) ON BACK OF BACK PLANE
   NO LESS THAN 3" FROM END

REV	DESCRIPTION	DATE	APPROVED
0	ORIGINAL ISSUE	09/07/07	RCG

REVISION HISTORY

UNIVERSAL
ELECTRIC CORPORATION

TITLE: PWR/DATA BUSWAY ASSEMBLY		
DRAWN BY: RCG	DATE: 9/7/2007	DWG NO.: 240-0001-0
APPR BY: SLR.	DATE: 11/16/07	
SCALE: 3/4	SHEET: 2	END USER